



CITY OF ORANGE BUILDING DIVISION


(2019 CRC)

WINDOW OPENINGS

1. EMERGENCY ESCAPE AT SLEEPING ROOMS & BASEMENTS ONLY

A. THE ESCAPE WINDOWS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 sq. ft WITH 24" MINIMUM NET CLEAR HEIGHT AND 20" MINIMUM NET CLEAR WIDTH. ESCAPE WINDOWS SHALL HAVE A FINISHED SILL HEIGHT NOT MORE THAN 44" ABOVE THE FLOOR.

(*) ON GROUND LEVEL ONLY 5 sq. ft MINIMUM NET CLEAR OPENING IS REQUIRED. (R310.2.1)

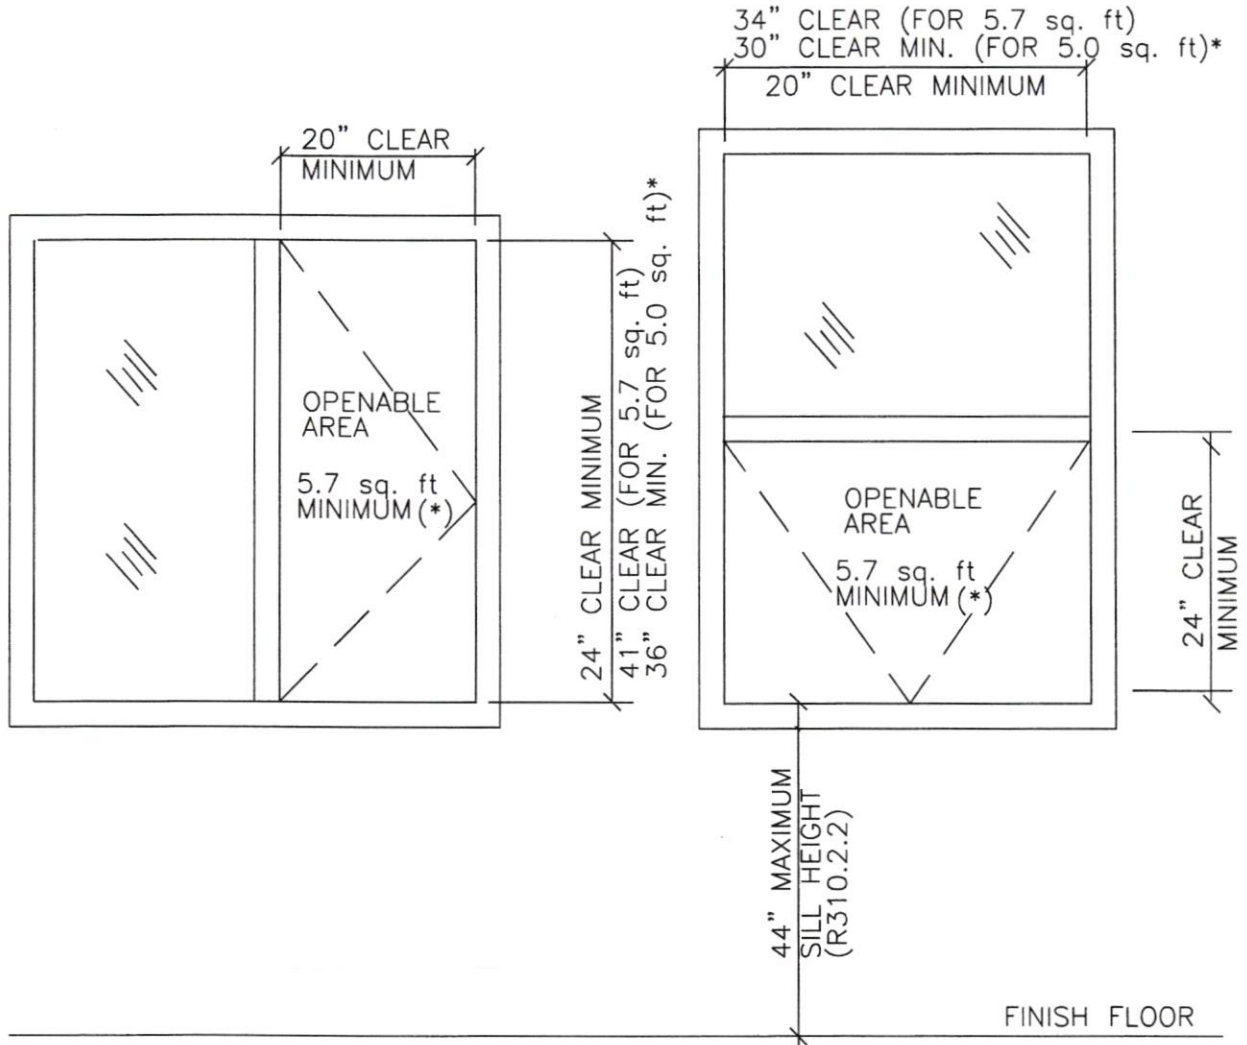

2. GENERAL NOTES FOR ALL WINDOWS:

- A. DO NOT REMOVE WINDOW LABELS BEFORE INSPECTION.
- B. ALL REPLACEMENT OR RETROFIT WINDOWS REQUIRE U-FACTOR OF 0.30 & SHGC OF 0.23 MAXIMUM.

OWNER:

ADDRESS:

APPLICANT'S SIGNATURE:

PERMIT NUMBER: