


JUMPER TO BE SUPPLIED BY DEVELOPER.	METER SIZE	A	B	C
	3/4"	7 3/4"	1" DIA.	1"
1"	10 3/4"	1 1/4" DIA.	1 1/4"	
1 1/2"	13"	2" DIA.	2"	
2"	17"	2" DIA.	2"	

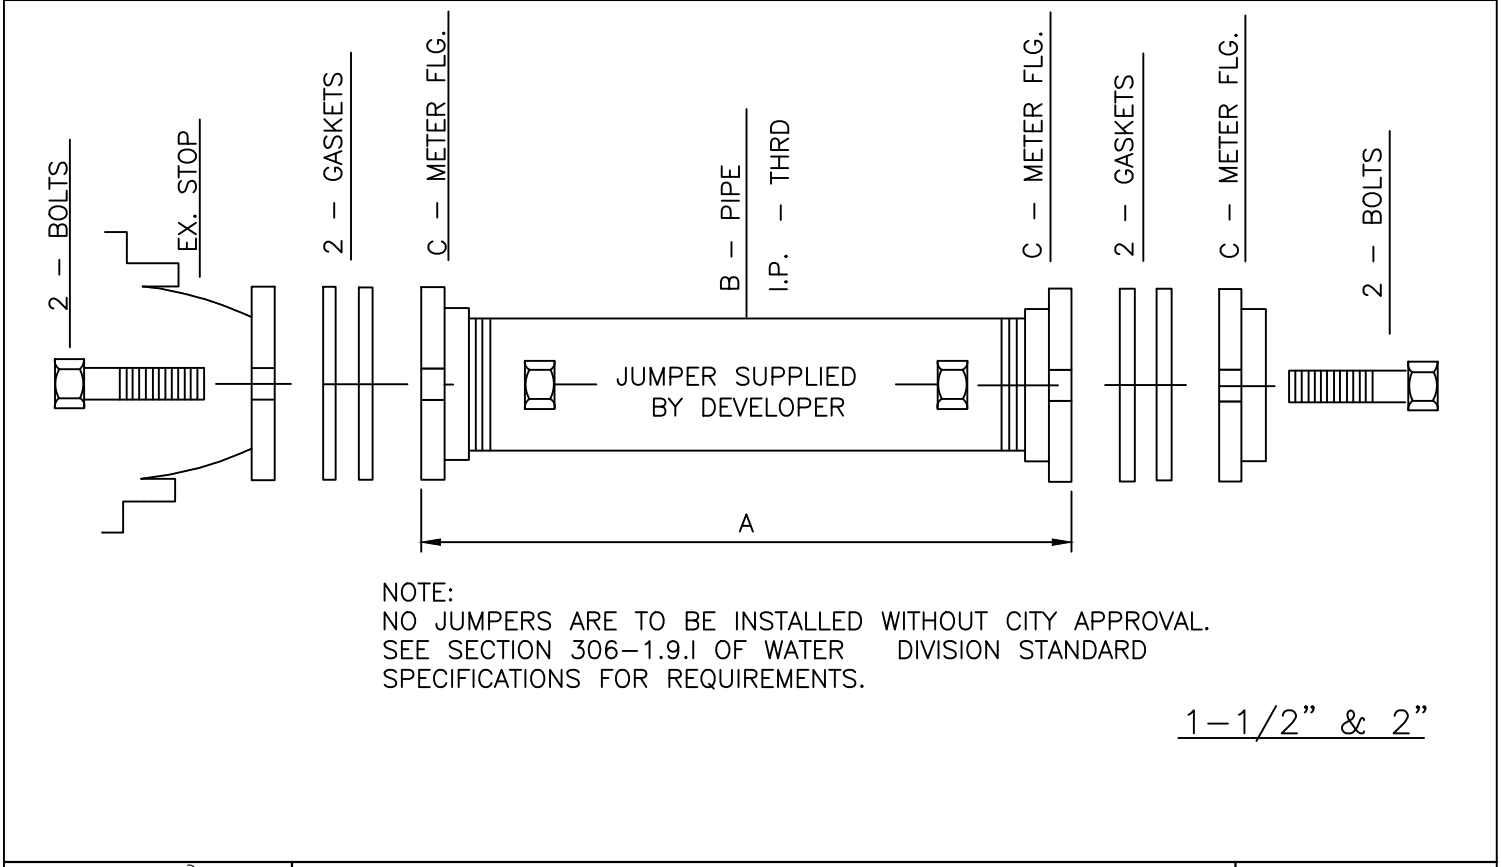

David Dief 1/31/2023
 CITY WATER MANAGER
James 1/31/2023
 CITY ENGINEER
John 1/31/2023
 PUBLIC WORKS DIRECTOR

CITY OF ORANGE WATER DIVISION STANDARDS
JUMPER INSTALLATION

OWD STD. DWG.
OWD-301
 SHEET 1 OF 1